
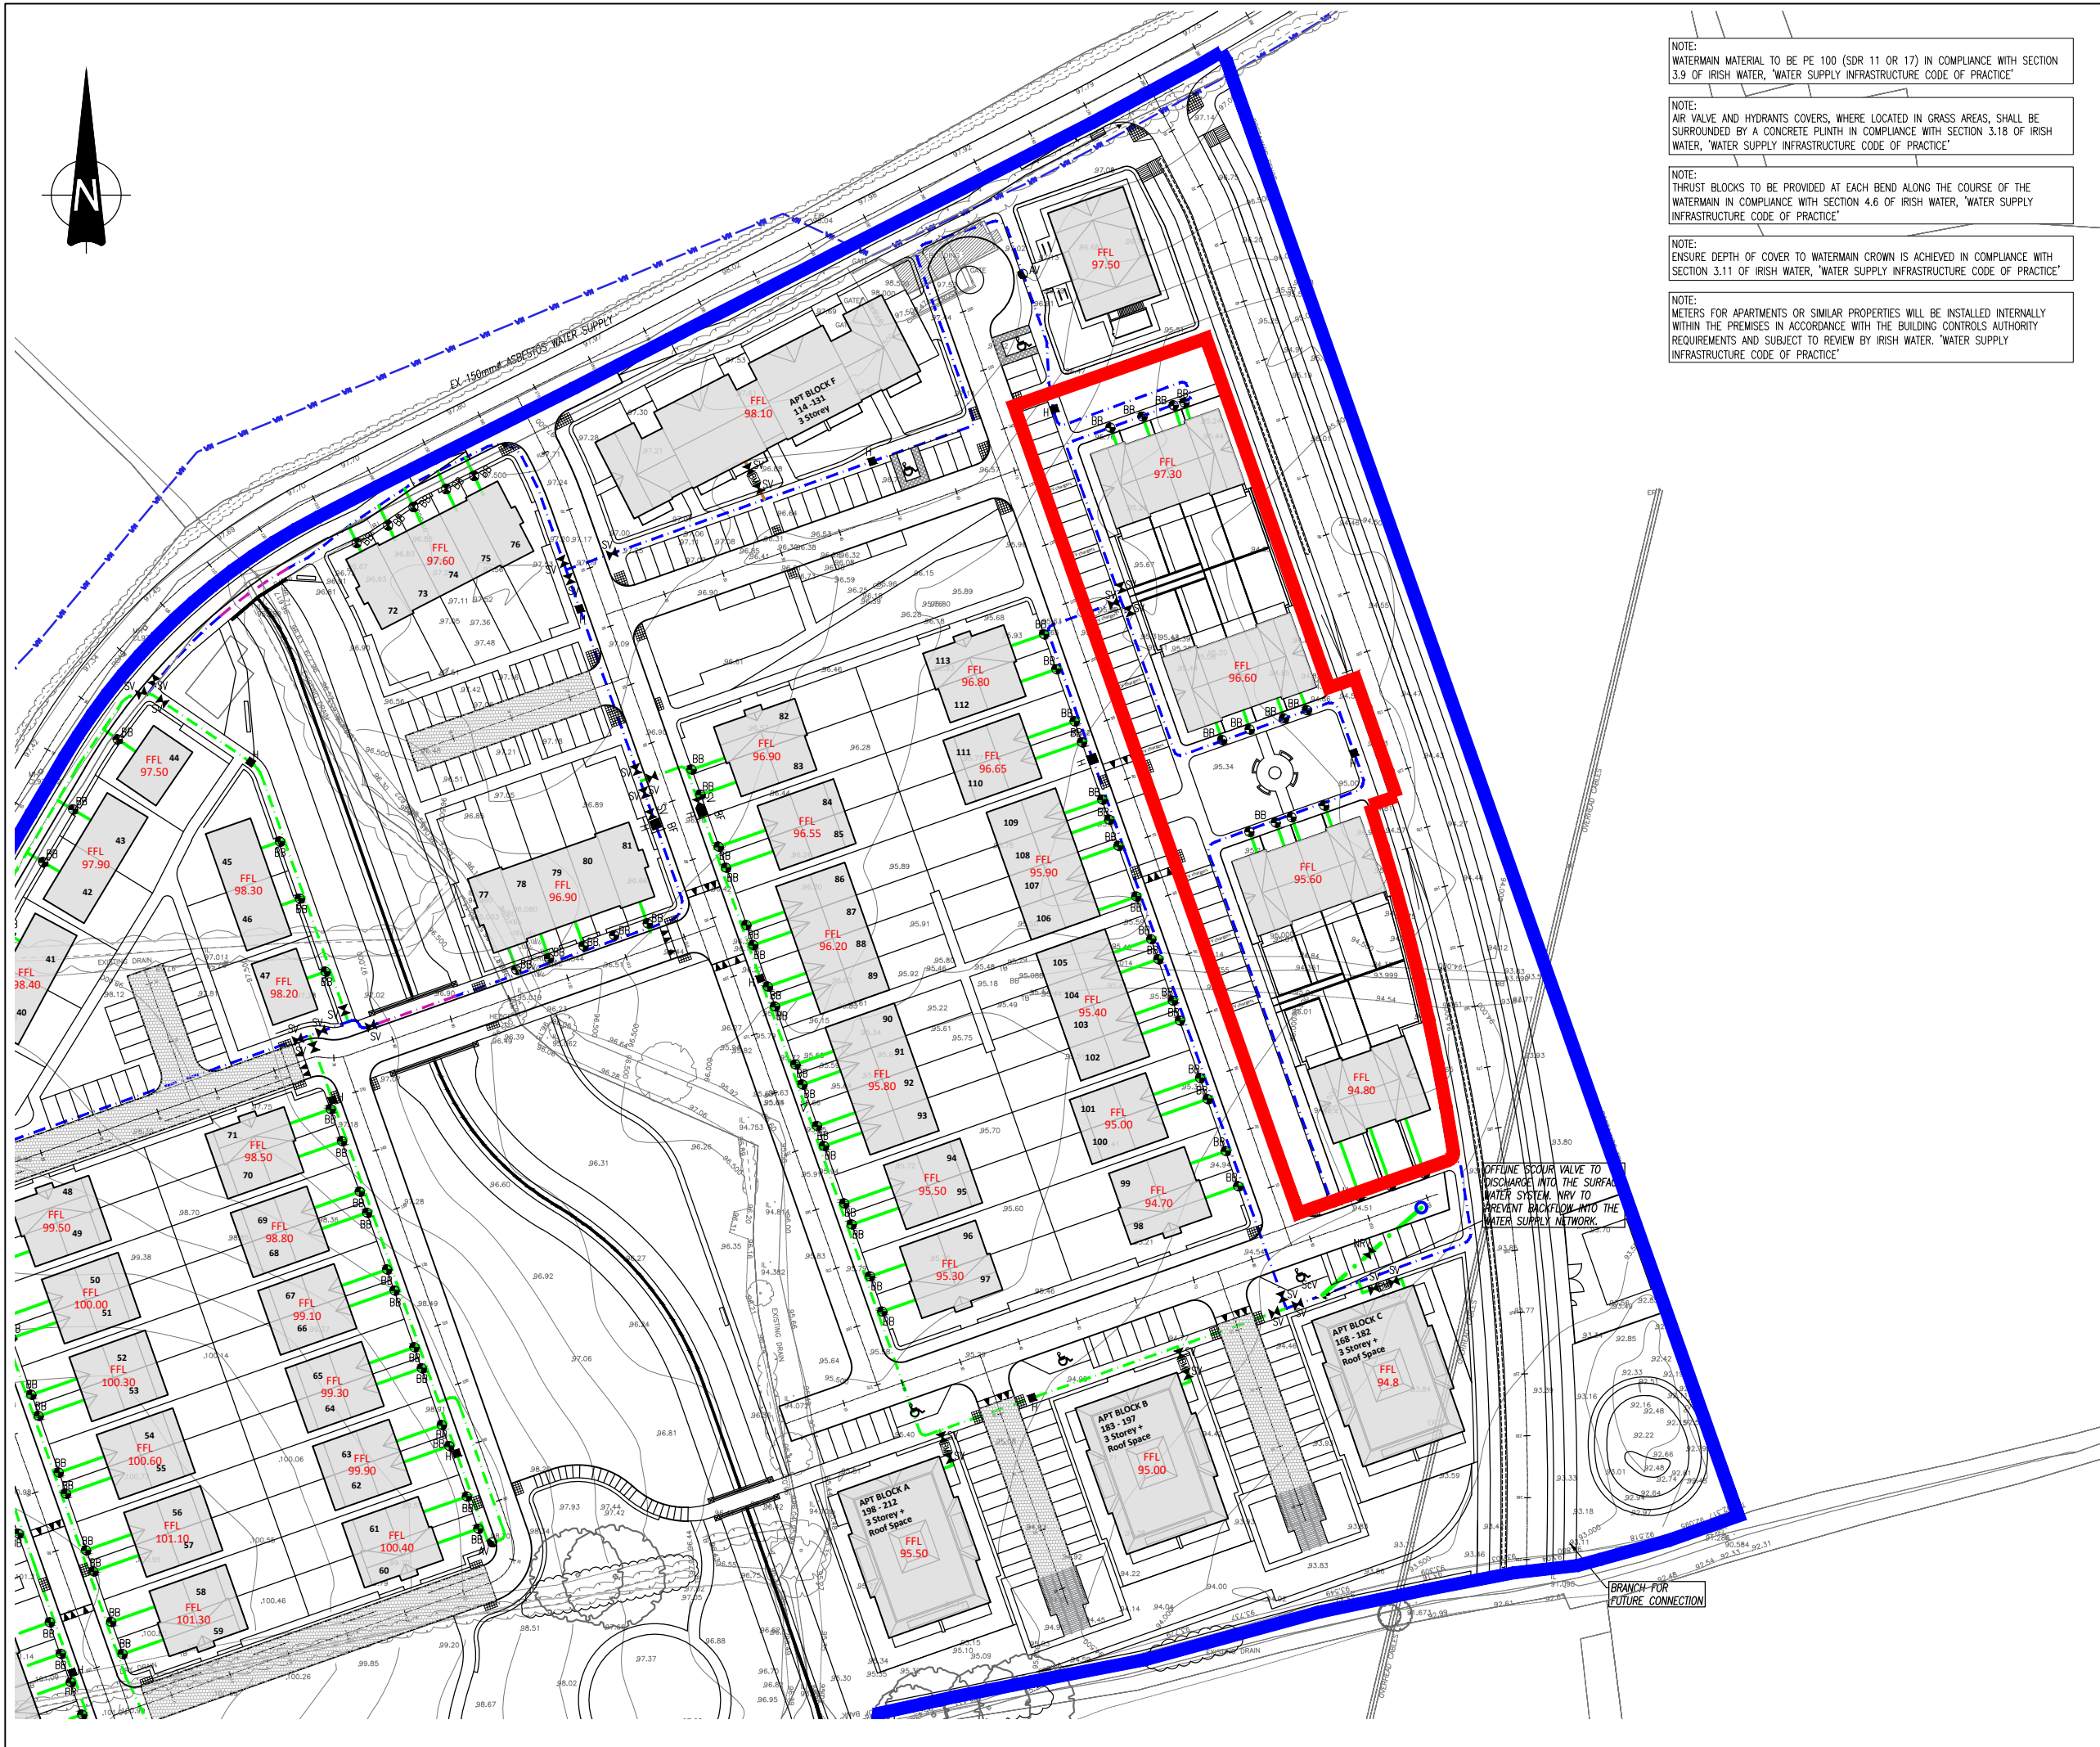




NOTE:
WATERMAIN MATERIAL TO BE PE 100 (SDR 11 OR 17) IN COMPLIANCE WITH SECTION 3.9 OF IRISH WATER, 'WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE'

NOTE:
AIR VALVE AND HYDRANTS COVERS, WHERE LOCATED IN GRASS AREAS, SHALL BE SURROUNDED BY A CONCRETE PLINTH IN COMPLIANCE WITH SECTION 3.18 OF IRISH WATER, 'WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE'



NOTE:
THRUST BLOCKS TO BE PROVIDED AT EACH BEND ALONG THE COURSE OF THE WATERMAIN IN COMPLIANCE WITH SECTION 4.6 OF IRISH WATER, 'WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE'

NOTE:
ENSURE DEPTH OF COVER TO WATERMAIN CROWN IS ACHIEVED IN COMPLIANCE WITH SECTION 3.11 OF IRISH WATER, 'WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE'

NOTE:
METERS FOR APARTMENTS OR SIMILAR PROPERTIES WILL BE INSTALLED INTERNALLY WITHIN THE PREMISES IN ACCORDANCE WITH THE BUILDING CONTROLS AUTHORITY REQUIREMENTS AND SUBJECT TO REVIEW BY IRISH WATER, 'WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE'

This drawing should not be scaled. Dimensions to be verified on site.
Any discrepancies should be referred to the Engineer prior to work being put in hand.
This drawing is the property of Waterman Moylan Consulting Engineers Limited and is issued on the condition that it is not copied, reproduced, retained or disclosed to any unauthorized person, either wholly or in part without the consent in writing of Waterman Moylan Consulting Engineers Limited.
Block S - East Point Business Park, Dublin D03 H3F4 Ireland
1-853 1 664 8900

- NOTES:
- DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS.

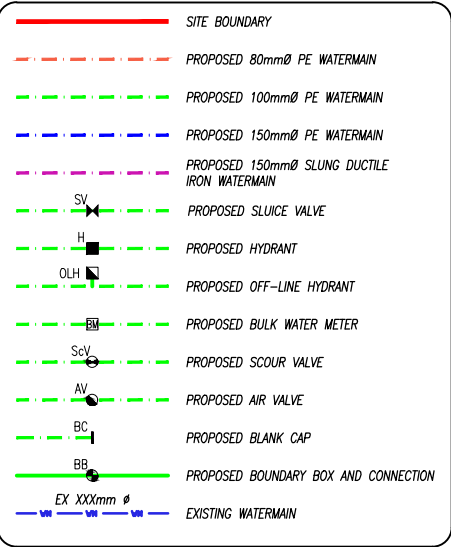

Project	GRANGE PARK, DUNSHAUGHLIN, CO. MEATH		
Title	PROPOSED WATER SUPPLY LAYOUT		
Client	LOUGHLINN DEVELOPMENTS LTD.		
			
BLOCK S, EASTPOINT BUSINESS PARK, ALFIE BYRNE ROAD, DUBLIN D03 H3F4 IRELAND. Tel: (01) 664 8900 Email: info@waterman-moylan.ie www.waterman-moylan.ie			
Status	FOR PLANNING ONLY		
Designed By	LS	Approved	BG
Drawn By	VU	Date	DEC. 2024
Project	Originator	Volume	Level
Number	Type	Role	Number
Revision			
BMR - WMC - ZZ - XX-DR- C -P1300			

OFFLINE SCOUR VALVE TO DISCHARGE INTO THE SURFACE WATER SYSTEM, W/RY TO PREVENT BACKFLOW INTO THE WATER SUPPLY NETWORK.

BRANCH FOR FUTURE CONNECTION